


## METER BASE ASSEMBLY FOR UNDERGROUND SERVICE

### SECONDARY H STRUCTURE

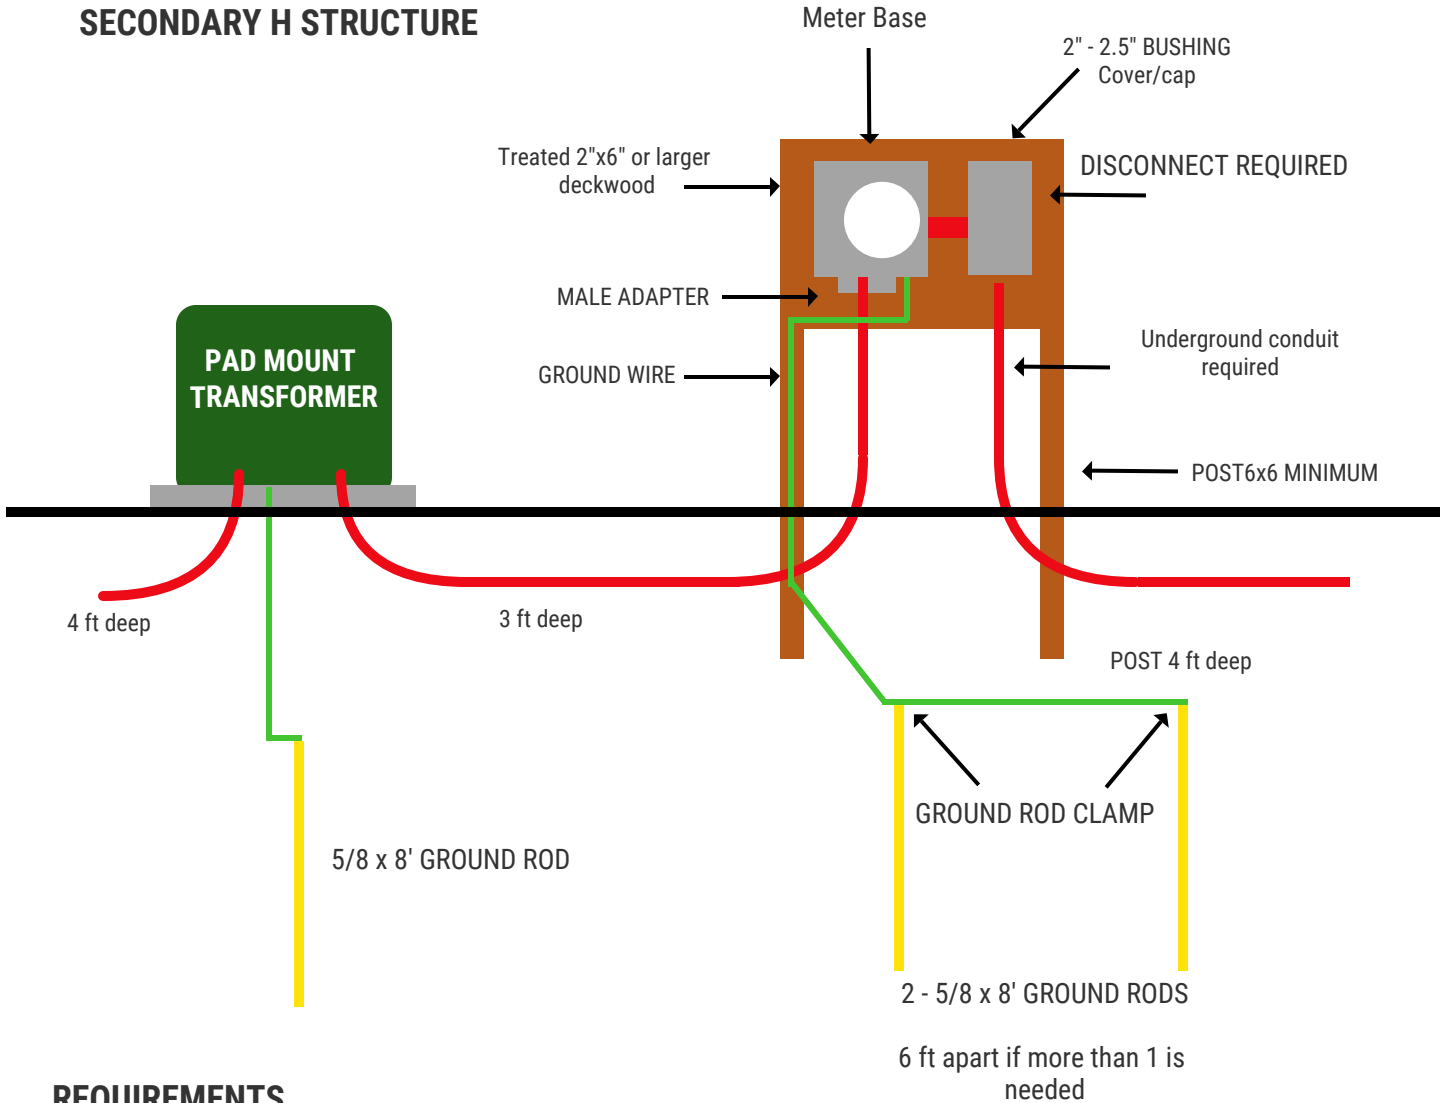

### REQUIREMENTS

- Ditch location must be approved by EBG personnel
- Meter base location must be approved by EBG personnel
- Ditch to be opened by owner and 3 ft deep
- Ditch must have clean and smooth bottom
- Conduit to be furnished and installed by owner
- Ditch and conduit must be inspected before covering
- Tape is supplied by EBG, but must be installed by owner 1 ft above conduit
- Communication conduits can be installed above the tape in the same ditch
- All secondary conduit must be schedule 40 PVC
- All connections must have Noalox, OxGard, or approved antioxidant compound

### WIRE SIZES

Disconnect	Copper Wire	Aluminum	Conduit
100 amp	#4	#2	2"
200 amp	#3/0	#4/0	2 1/2"
Equipment ground	#4 copper	#4 copper	